

Materialprüfungsamt Nordrhein-Westfalen - 44285 Dortmund

DORMA Deutschland GmbH
DORMA Platz 1
58256 Ennepetal
Germany

Ihr Zeichen: PS
Ihre Nachricht vom : 20.04.2016
Unser Zeichen: Mei
Durchwahl: 493
Direktfax: +49 (0)231 4502 586
E-Mail: meinks@mpanrw.de
Datum: 21.06.2016

Extension of validity of a test certificate.

Dear Ladies and Gentleman,

Concerning the results of the initial type test carried out with the controlled door closing device DORMA TS 72 BCA EN 2-4 you applied for the extension of validity of test certificate no. 12001031.11-02.

The tests have been carried out on the base of the DIN EN 1154: 2003-04 (see test report no. 120001031.11-01).

Today the EN 1154:1996 / A1:2002 / AC:2006 is valid.

The changes which have been made within the revision of this version of the DIN EN 1154 have no influence to the results and the classification of the door closer DORMA 72 BCA EN 2-4.

You have also assured that the door closer was not modified since the initial type test.

Therefore the validity of the test certificate no. 12001031.11-02 is extended up to July, 1st 2021.

Best regards
By order



H. Jansen
Head of the test laboratory

Hausanschrift
Marsbruchstraße 186
D-44287 Dortmund
Telefon (0231) 45 02-0
Telefax (0231) 45 85 49
E-Mail: info@mpanrw.de

Bahnstation: Dortmund-Hbf.
Telegramme: prüfamt Dortmund
Öffentliche Verkehrsmittel
Stadtbahn U47 ab Hbf.
Richtung Aplerbeck
bis „Allerstraße“

Außenstelle Erwitte
Auf den Thränen
D-59597 Erwitte
Telefon (0 29 43) 897-0
Telefax (0 29 43) 897-33
E-Mail: info@mpanrw.de

Bankverbindungen
Landeszentralbank Dortmund
(BLZ 440 000 00)
Kto. 440 018 15
Ust.-IdNr.: DE 124 728 648

Test Certificate No. 12001031.11-02

Contracting Party

Dorma GmbH & Co. KG
Breckerfelder Str. 42-48
D-58256 Ennepetal

Assignment

Testing of controlled door closing devices (door closer) in accordance with DIN EN 1154: 2003-04 (Ref. No. EN 1154: 1996 D +A1:2002). The tests are to be including the additional requirements according to annex A of DIN EN 1154.

Description of Samples

Overhead door closer surface mounted with adjustable latch, adjustable backcheck and projecting arm in accordance with illustration C.1.1 of DIN EN 1154 „**Dorma TS 72 BCA EN 2-4**“.

Description of the Test and Test Results

See Test Report No. 120001031.11-01.

Door leaf fixing corresponding with appendix 1 and 2.

Evaluation of the Test Results

The door closer „**Dorma TS 72 BCA EN 2-4**“ with a projecting arm mounted as shown on appendix 1 fulfils the requirements of the DIN EN 1154.

It is classified as follows in accordance with sec. 4 of DIN EN 1154:

4	8	2 4	1	1	2
---	---	--------	---	---	---

Dortmund, June 21st, 2006




Thorsten Meinks
Technischer Amtsinspektor


DORMA

TS 72 BCA EN 2-4



WN 055816
02/02

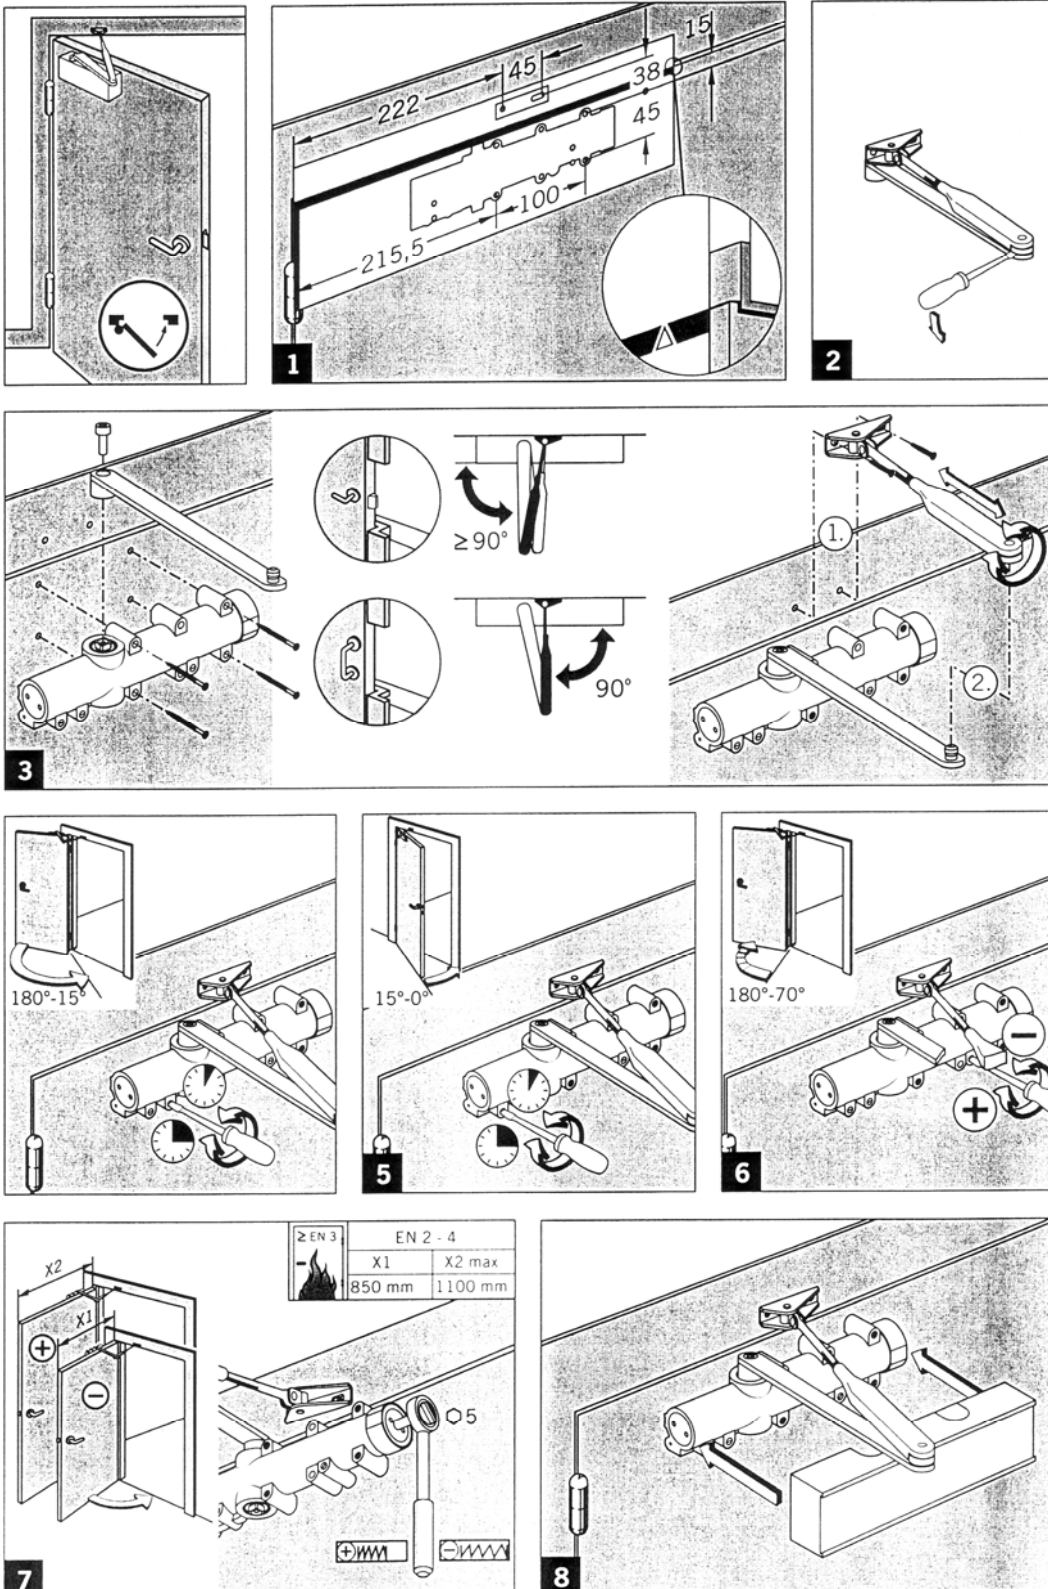

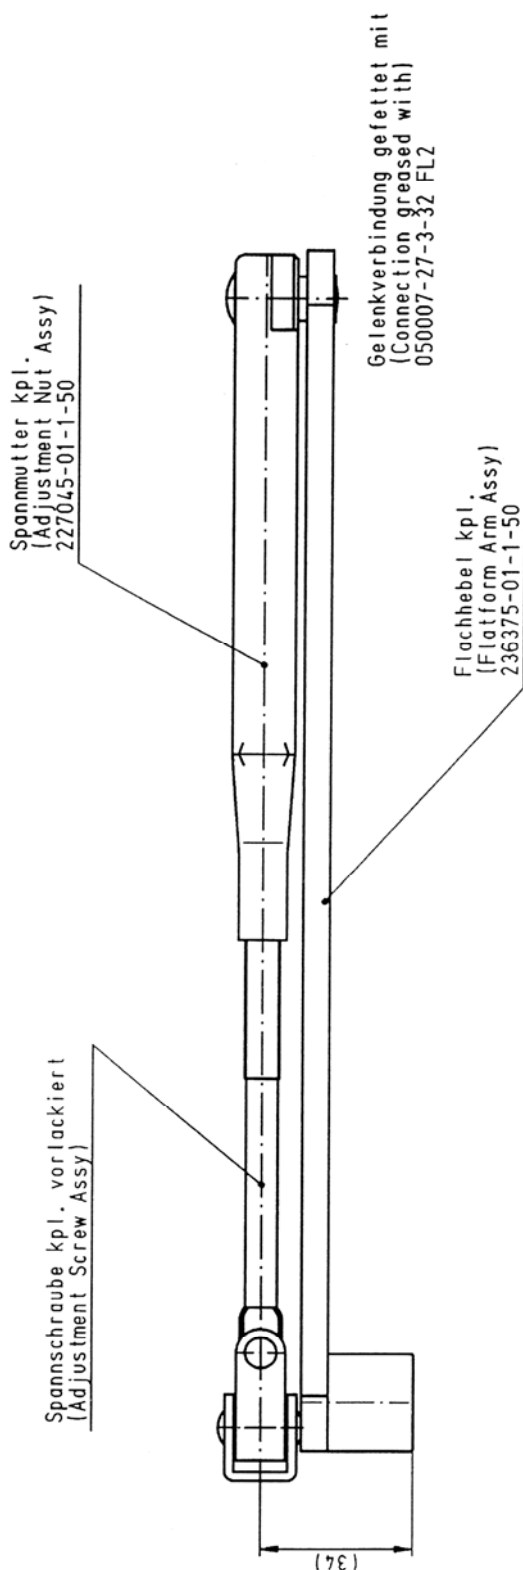

Var.	Spannschraube kpl. (Adj. Screw Assy)	verlackiert (Prepaint)
01	235102-01-1-50	silber/silver
02	235102-02-1-50	d.braun/darkbrown
03	235102-03-1-50	Sonderf./special
04	235102-04-1-50	RAL 9010 weiß/white
05	235102-05-1-50	RAL 9016 weiß/white
06	235102-06-1-50	RAL 9005 schwarz/black
07	235102-07-1-50	messing/farbin/brass

[illegible]